


EQUIPMENT LIST

- (A) 5) A1004-010 EMCO WHEATON 5 GAL CONTAINMENT MANHOLE
- (B) 3) A97-005 EMCO WHEATON 4" FILL CAP
- (C) 3) A1100-056 EMCO WHEATON OVERFILL PREVENTION VALVE W/DROP TUBE
- (D) 3) A30-014 EMCO WHEATON 4" VAPOR ADAPTER
- (E) 2) A99-002 EMCO WHEATON 4" VAPOR CAP
- (F) 2) A76-005 EMCO WHEATON VAPOR ADAPTER
- (G) TS-100/4-P INCON TANK LEVEL AND MONITORING CONSOLE
- (H) 3) 400-16R BAKER INDUSTRIES 16" ROUND MANHOLE

- (I) TSP-K12 INCON 2" RISER CAP
- (J) TSP-ETS INCON ELECTRO-OPTIC LIQUID SENSOR
- (K) 3) TSP-K4A INCON 4" RISER CAP PROBE KIT
- (L) 3) TSP-LL2-125 INCON TANK LEVEL PROBE
- (M) 3) STP-CB FE PETRO TURBINE RELAY BAQX
- (N) 3) AC-42 AMERICAN CONTAINMENT 42" FIBERGLASS SUMP
- (O) 3) 400-36RLE BAKER INDUSTRIES 36" RIAN TIGHT MANHOLE
- (P) 412-40 UNIVERSAL 4" EXTRACTOR CAP

- (Q) V421-2020 UNIVERSAL VENT LINE EXTRACTOR HOUSING
- (S) 2) STP-75 FE PETRO 3/4HP SUBMERSIBLE PUMP
- (T) 3) STP-MLD FE PETRO PISTON LINE LEAK DETECTOR
- (U) 2) 749CRB0660 MORRISON BROS 2" P/V VENT CAP
- (V) 45-20 UNIVERSAL 2" VENT CAP
- (X) 3) TSPTSP-DTS INCON DISCRIMINATING SUMP SENSOR
- (Y) TMS-ROM INCON 2/4 RELAY OUTPUT MODULE
- (Z) STP-150 FE PETRO 1 1/2-HP SUBMERSIBLE PUMP

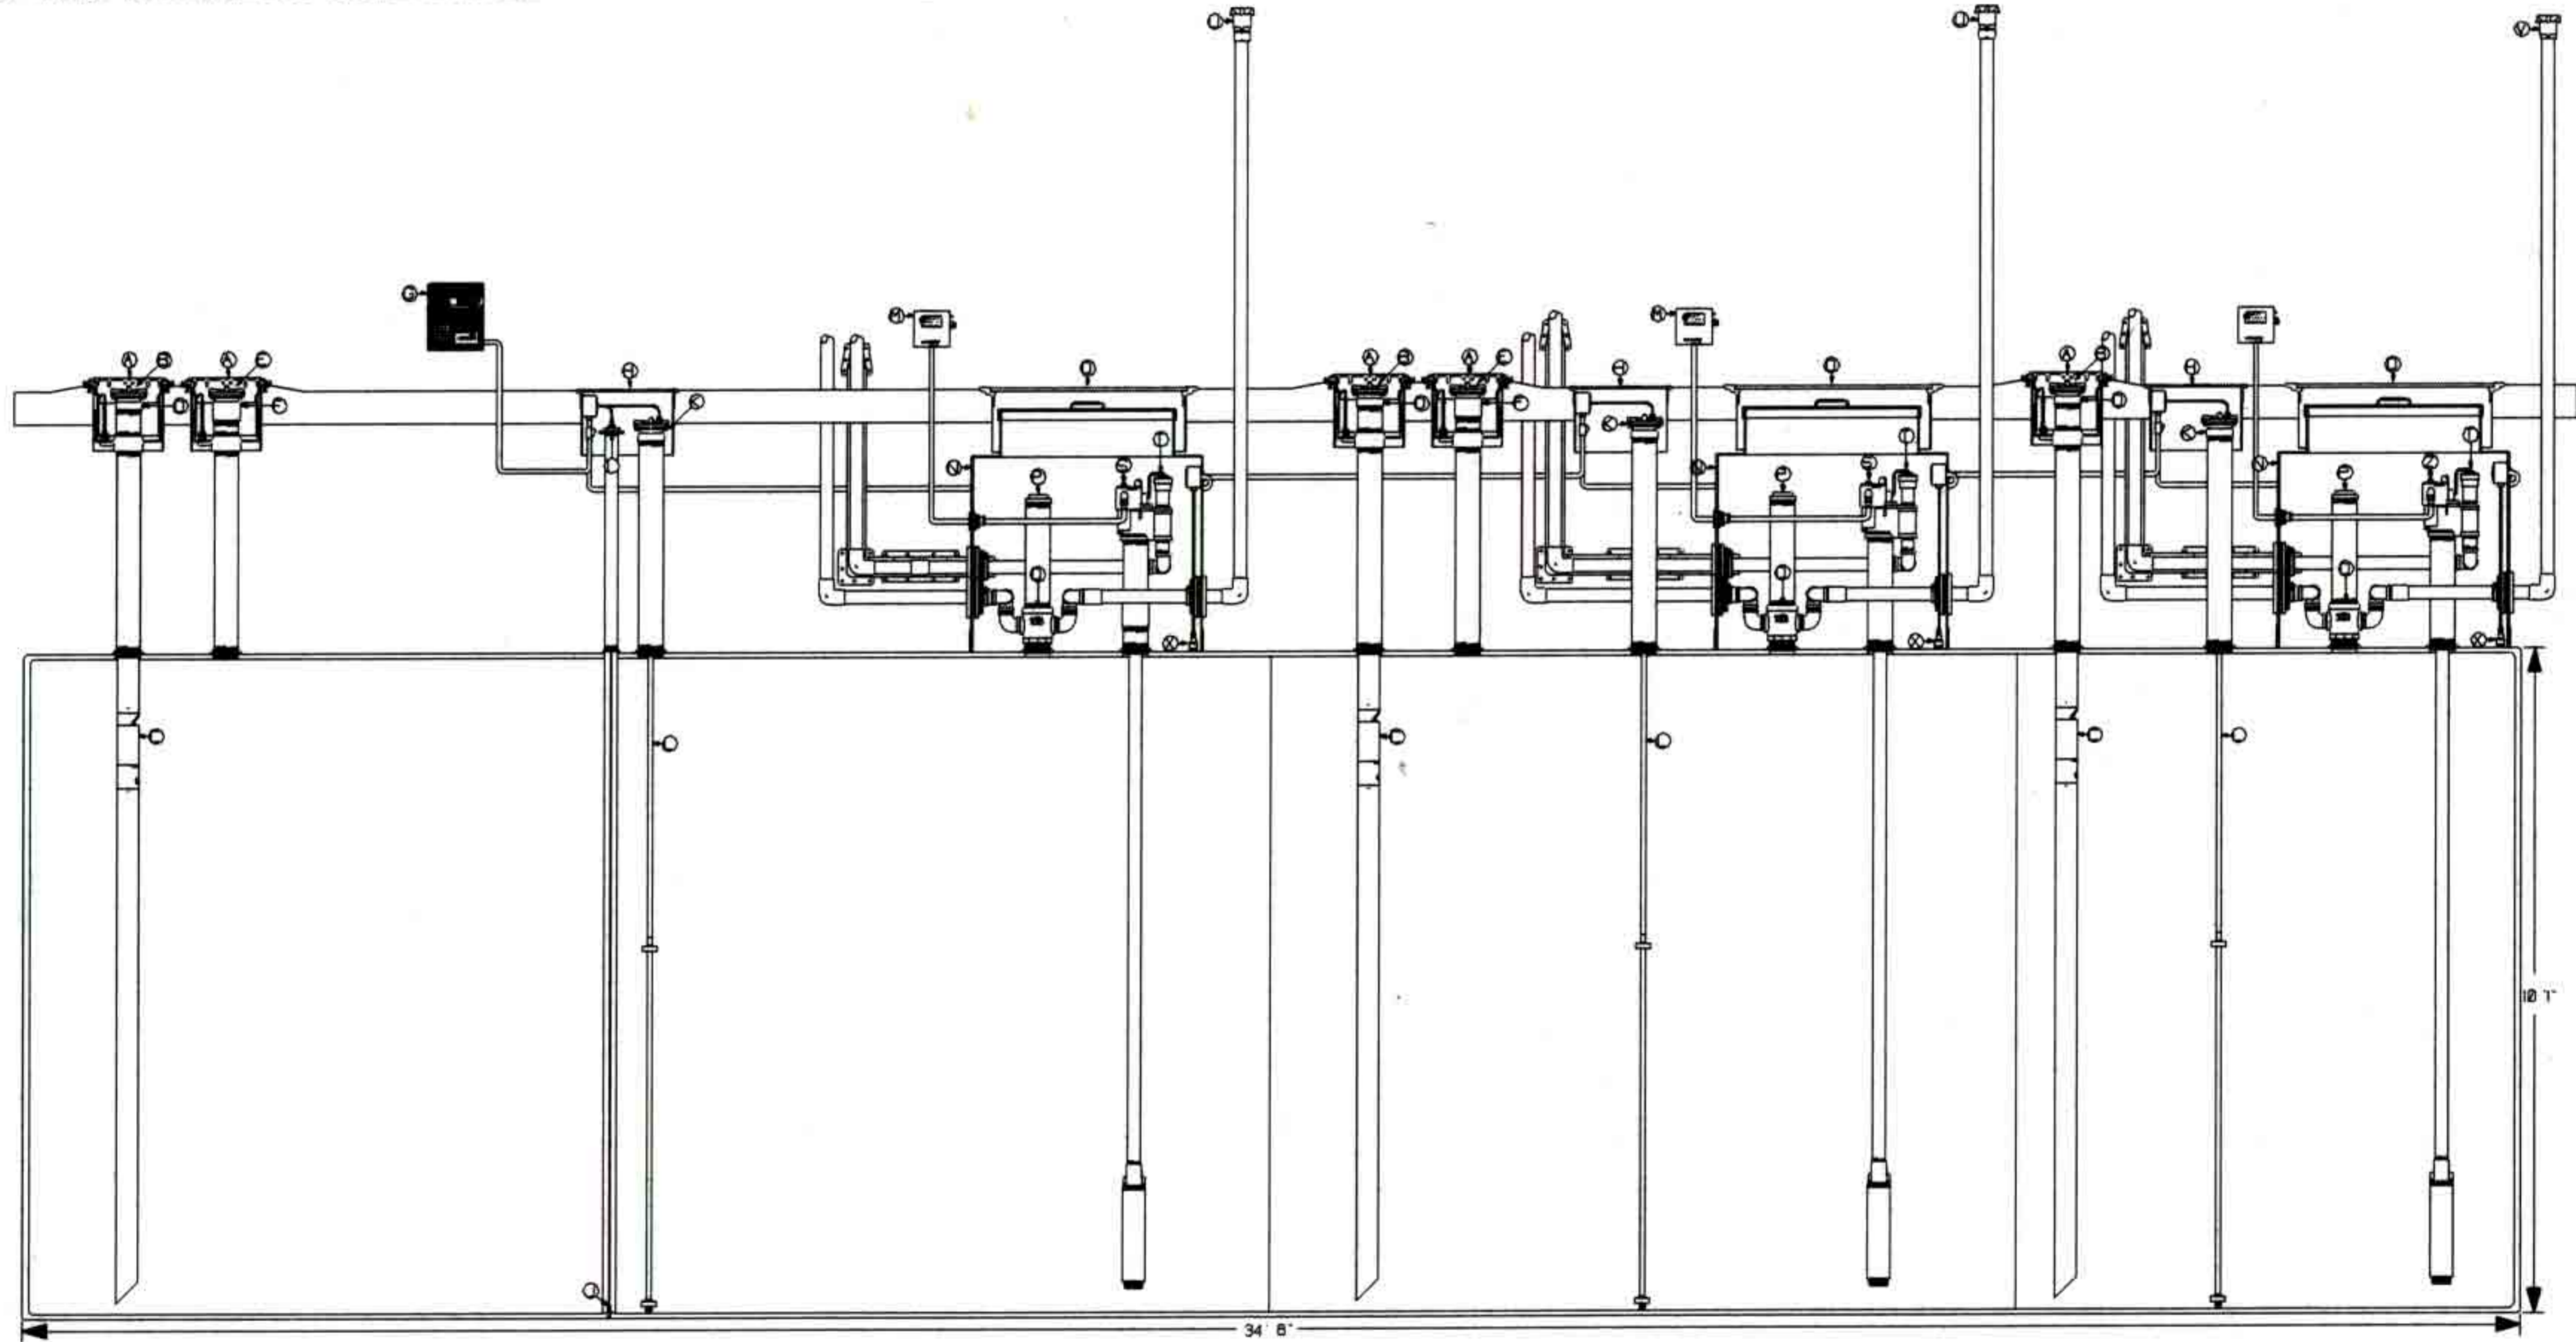

Shields, Harper & Co.
 AN EMPLOYEE OWNED COMPANY

© Copyright, Shields, Harper & Co., 1988-2003
 All rights reserved

5107 BROADWAY
 OAKLAND, CA 94611
 (510) 653-9119

2699 DEL MONTE
 WEST SACRAMENTO, CA 95691
 (916) 372-0440

2567 SOUTH SARAH AVE.
 FRESNO, CA 93706
 (209) 266-8101

626 N. ECKHOFF
 ORANGE, CA 92668
 (714) 634-1518

280 GREG ST., UNIT 11
 RENO, NV 89502
 (775) 329-7867

3602 E. SOUTHERN AVE., SUITE 3
 PHOENIX, AZ 85040
 (602) 438-6590

**THIS DIAGRAM IS FOR ILLUSTRATION PURPOSES ONLY
 AND IS NOT TO BE RELIED UPON FOR ANY OTHER
 PURPOSE. NO WARRANTY OF MERCHANTABILITY, OF
 FITNESS FOR A PARTICULAR PURPOSE OR OF ANY
 OTHER KIND, EXPRESSED OR IMPLIED, IS HEREBY MADE.**

BY: JAG JJC/NJ
 DATE: 10/13/22
 SCALE: NONE
 DWG: COMPARTMENT-20K
 DWGS FILE: 303