


12,000gal MODERN WELDING FIREGUARD CYLINDRICAL ABOVEGROUND COMPARTMENT TANK (7,000gal UNLEADED / 5,000gal PREMIUM)

EQUIPMENT LIST

(A) 3/4" WAYNE VISTA 3 PRODUCT BLENDER (TYP OF 2)
 (B) DM1129S2 WESTERN FIBERGLASS DISPENSER SUMP (TYP OF 2)
 (C) TR242436B WESTERN FIBERGLASS TRANSITION SUMP
 (D) 2) STP-CBS FE PETRO PUMP CONTROL BOX
 (E) 2) STP-75R-VL2 FE PETRO 3/4HP SUBMERSIBLE PUMP WITH STP-MLD-1 LEAK DETECTOR
 710-0200 MORRISON SOLENOID VALVE
 691BSS-0800 MORRISON LOCKING BALL VALVE
 111504E-32-0120 TITFLEX FIRESAFE CONNECTOR

(F) 2) 623V-3203 OPW PRESSURE VACUUM VENT
 (G) 2) 818-0100 MORRISON CLOCK-FACED GAUGE
 (H) 2) 312020-052 VEEDER ROOT 4" CAP & RING KIT
 (I) 2) 847390-307 VEEDER ROOT LEVEL PROBE
 (J) 2) 3" OVERFILL VALVE
 (K) 2) SIDE MOUNTED FILL SPILL CONTAINMENT BOX (GAS)
 (L) 1711T-7085 OPW VAPOR CAP W/ 1611AV-1605 ADAPTER
 (M) 2) 2440I-0600 MORRISON 8" EMERGENCY VENT

(N) 2440I-0200 MORRISON 6" EMERGENCY VENT
 (O) 312020-928 VEEDER ROOT 2" CAP KIT
 (P) 794390-420 VEEDER ROOT INTERSTITIAL SENSOR
 (R) TLS-350 VEEDER ROOT TANK MONITOR CONSOLE
 (S) 790091-001 VEEDER ROOT OVERFILL ALARM
 (T) 790095-001 VEEDER ROOT ALARM ACKNOWLEDGEMENT

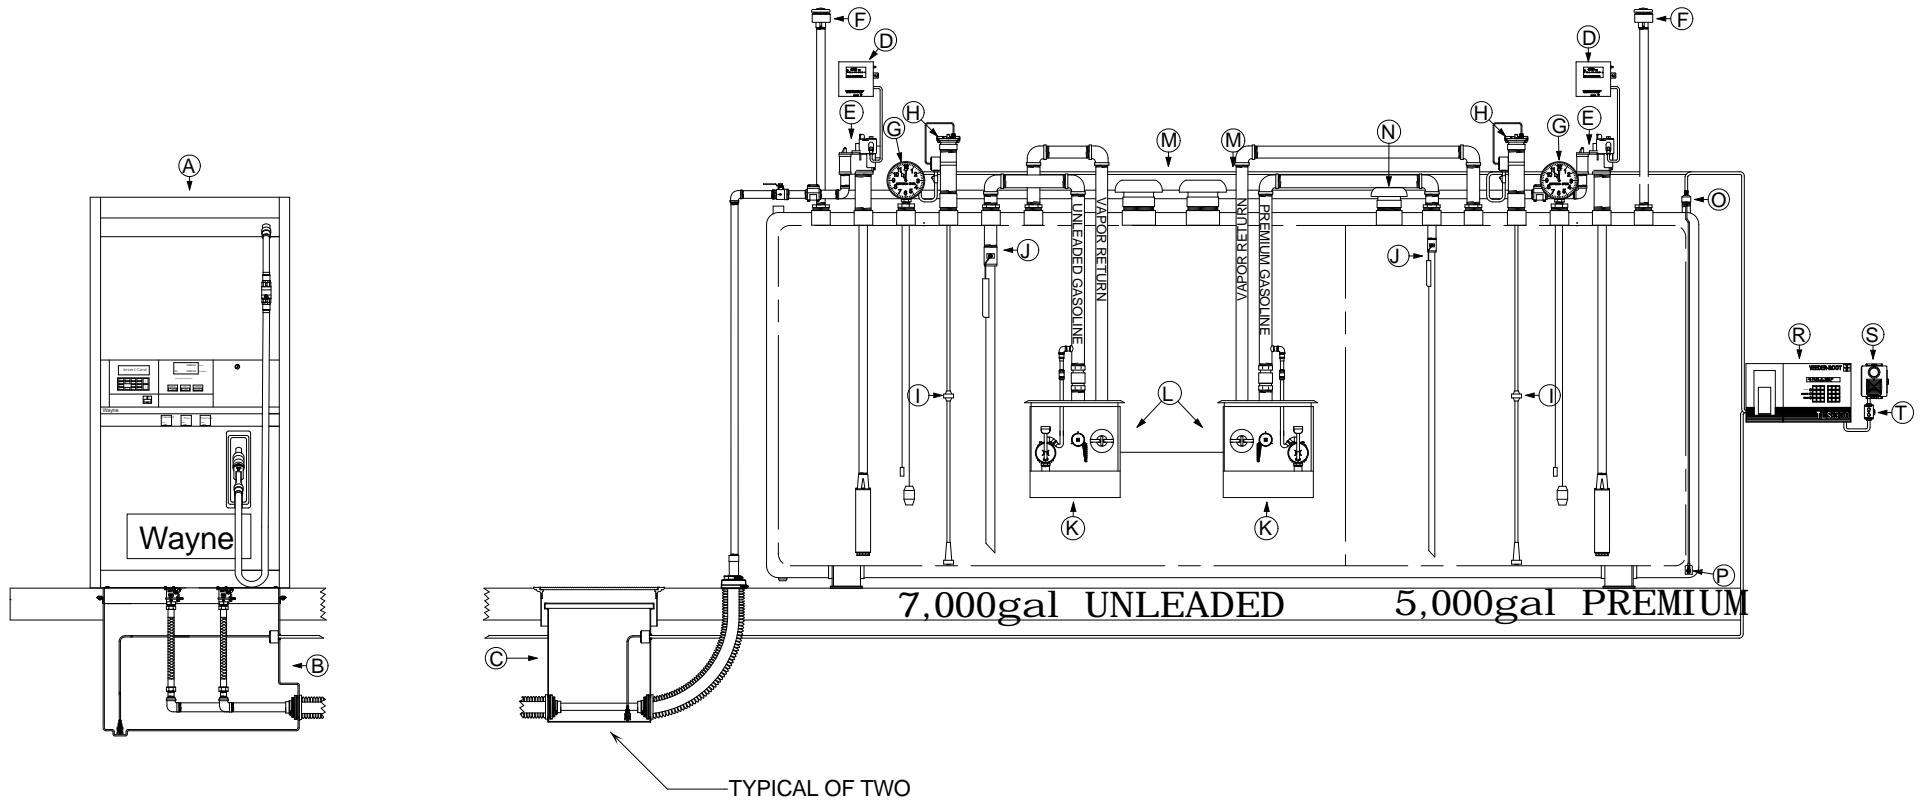

Shields, Harper & Co.
AN EMPLOYEE OWNED COMPANY

© Copyright, Shields, Harper & Co., 1988-2006
All rights reserved

5107 BROADWAY
OAKLAND, CA 94611
(510) 653-9119

2699 DEL MONTE
WEST SACRAMENTO, CA 95691
(916) 372-0440

2567 SOUTH SARAH AVE.
FRESNO, CA 93706
(209) 266-8101

731 W. ANGUS AVE.
ORANGE, CA 92668
(714) 288-2029

280 GREG ST., UNIT 11
RENO, NV 89502
(775) 329-7867

3602 E. SOUTHERN AVE., SUITE 3
PHOENIX, AZ 85040
(602) 438-6590

9180 CHESAPEAKE DRIVE
SAN DIEGO, CA 92123
(619) 277-9093

6283 DEAN MARTIN DRIVE
LAS VEGAS, NV 89118
(702) 413-1014

THIS DIAGRAM IS FOR ILLUSTRATION PURPOSES ONLY AND IS NOT TO BE RELIED UPON FOR ANY OTHER PURPOSE. NO WARRANTY OF MERCHANTABILITY, OF FITNESS FOR A PARTICULAR PURPOSE OR OF ANY OTHER KIND, EXPRESSED OR IMPLIED, IS HEREBY MADE.

BY: JAC (DB/N)
DATE: 6/23/06
SCALE: NONE
DWG OR FILE: 12K-AST-SPLIT
DWGS FILE: 606